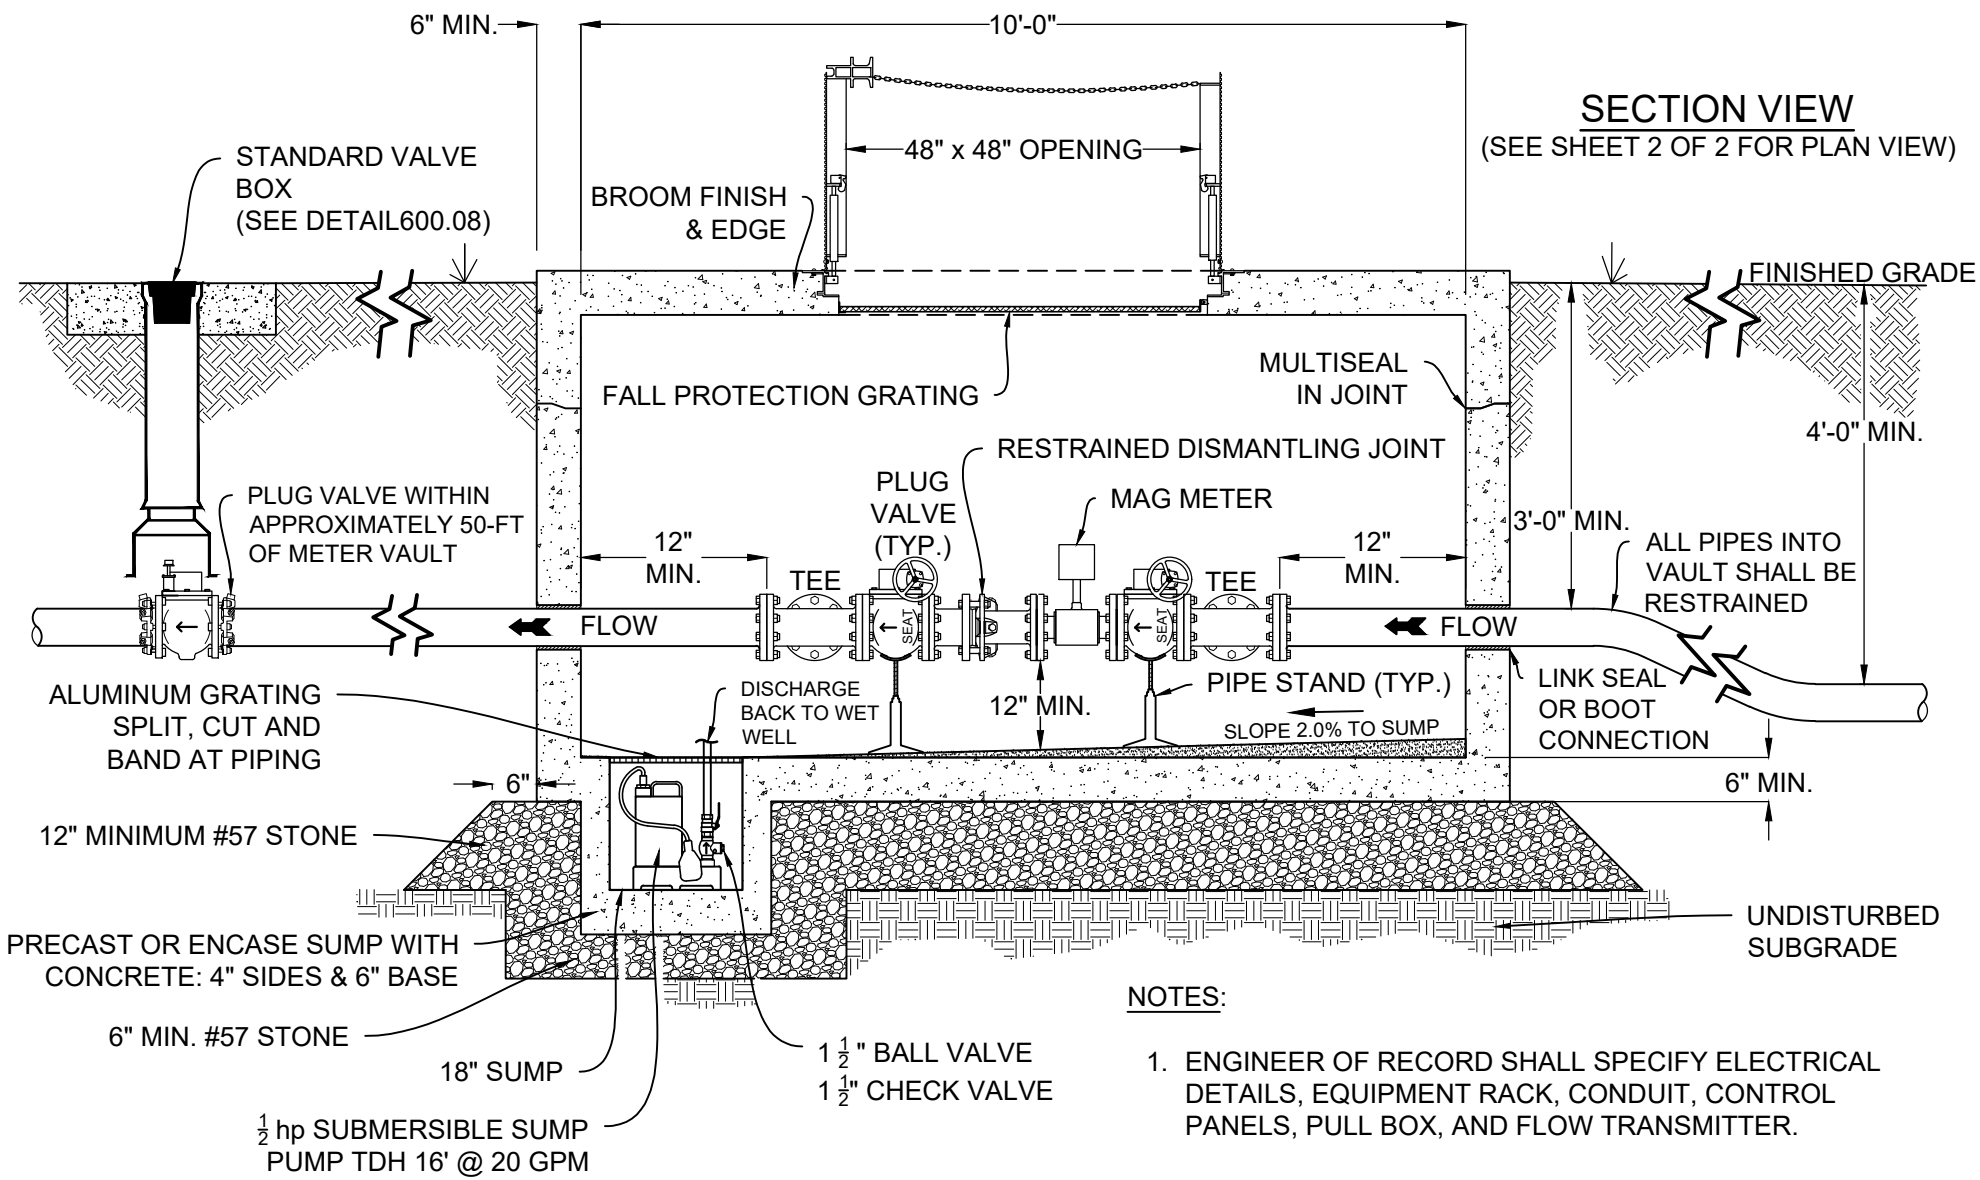

NOTES:

1. ENGINEER OF RECORD SHALL SPECIFY ELECTRICAL DETAILS, EQUIPMENT RACK, CONDUIT, CONTROL PANELS, PULL BOX, AND FLOW TRANSMITTER.
2. ENGINEER OF RECORD SHALL COORDINATE PLC LOGIC WITH OWNER.
3. ACCESS HATCH SHALL BE CENTERED OVER METER.

TOWN OF APEX STANDARDS	STANDARD MAG METER INSTALLATION	STD. NO.
EFFECTIVE: MARCH 23, 2021		800.04
		SHEET 1 OF 2