


NOTES:

1. METER YOKE - MUELLER, MCDONALD OR FORD WITH LOCKABLE BY-PASS AND METER STOPS.
2. BOX MAY BE CONCRETE (STAY RIGHT MB 2737 OR EQUAL) OR LIGHTWEIGHT POLYMER CONCRETE.
3. WATER SERVICES GREATER THAN $\frac{3}{4}$ " IN SIZE USED IN GANG METER INSTALLATIONS SHALL REQUIRE DESIGN CALCULATIONS, CERTIFIED BY A PROFESSIONAL ENGINEER AND SUBMITTED TO THE TOWN BEFORE CONSTRUCTION PLAN APPROVAL.
4. SEE SECTION 602 F.3 FOR METER INSTALLATION CONDITIONS.

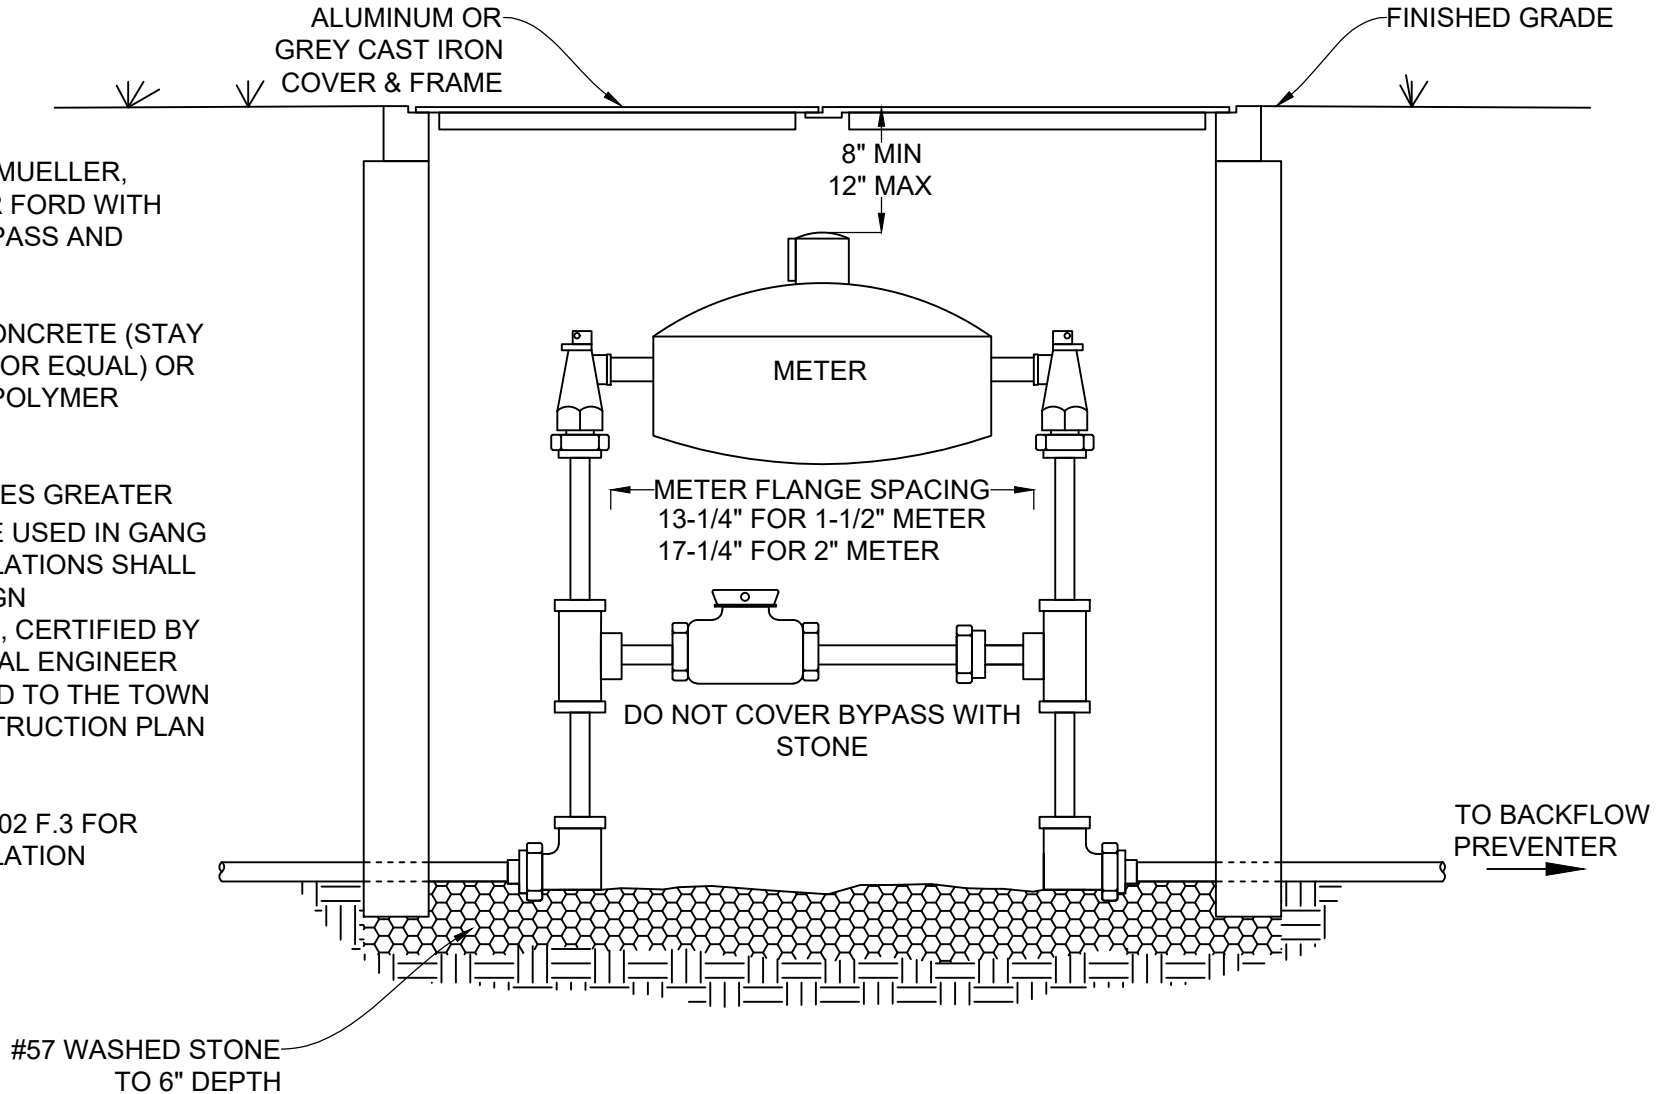

TOWN OF APEX
STANDARDS

EFFECTIVE: MARCH 23, 2021

1-1/2" & 2" METER INSTALLATION & VAULT

STD. NO.

600.02

SHEET 1 OF 1