NOTES:

1. WITNESS POST TO BE INSTALLED UPRIGHT WITH THE CAST 'MV' FACING THE NEAREST STREET.
2. DIRECTION AND DISTANCE MUST BE ETCHED OR STAMPED INTO THE BRONZE INSERT.
3. ONE POST TO BE INSTALLED FOR EACH VALVE LOCATED OUTSIDE OF THE PAVEMENT.
4. WITNESS POST TO BE INSTALLED AT THE RIGHT OF WAY.
5. NO POST REQUIRED FOR FIRE HYDRANT ISOLATION VALVES.
6. PLASTIC MARKER POST SHALL BE ACCEPTABLE IN LIEU OF CONCRETE.

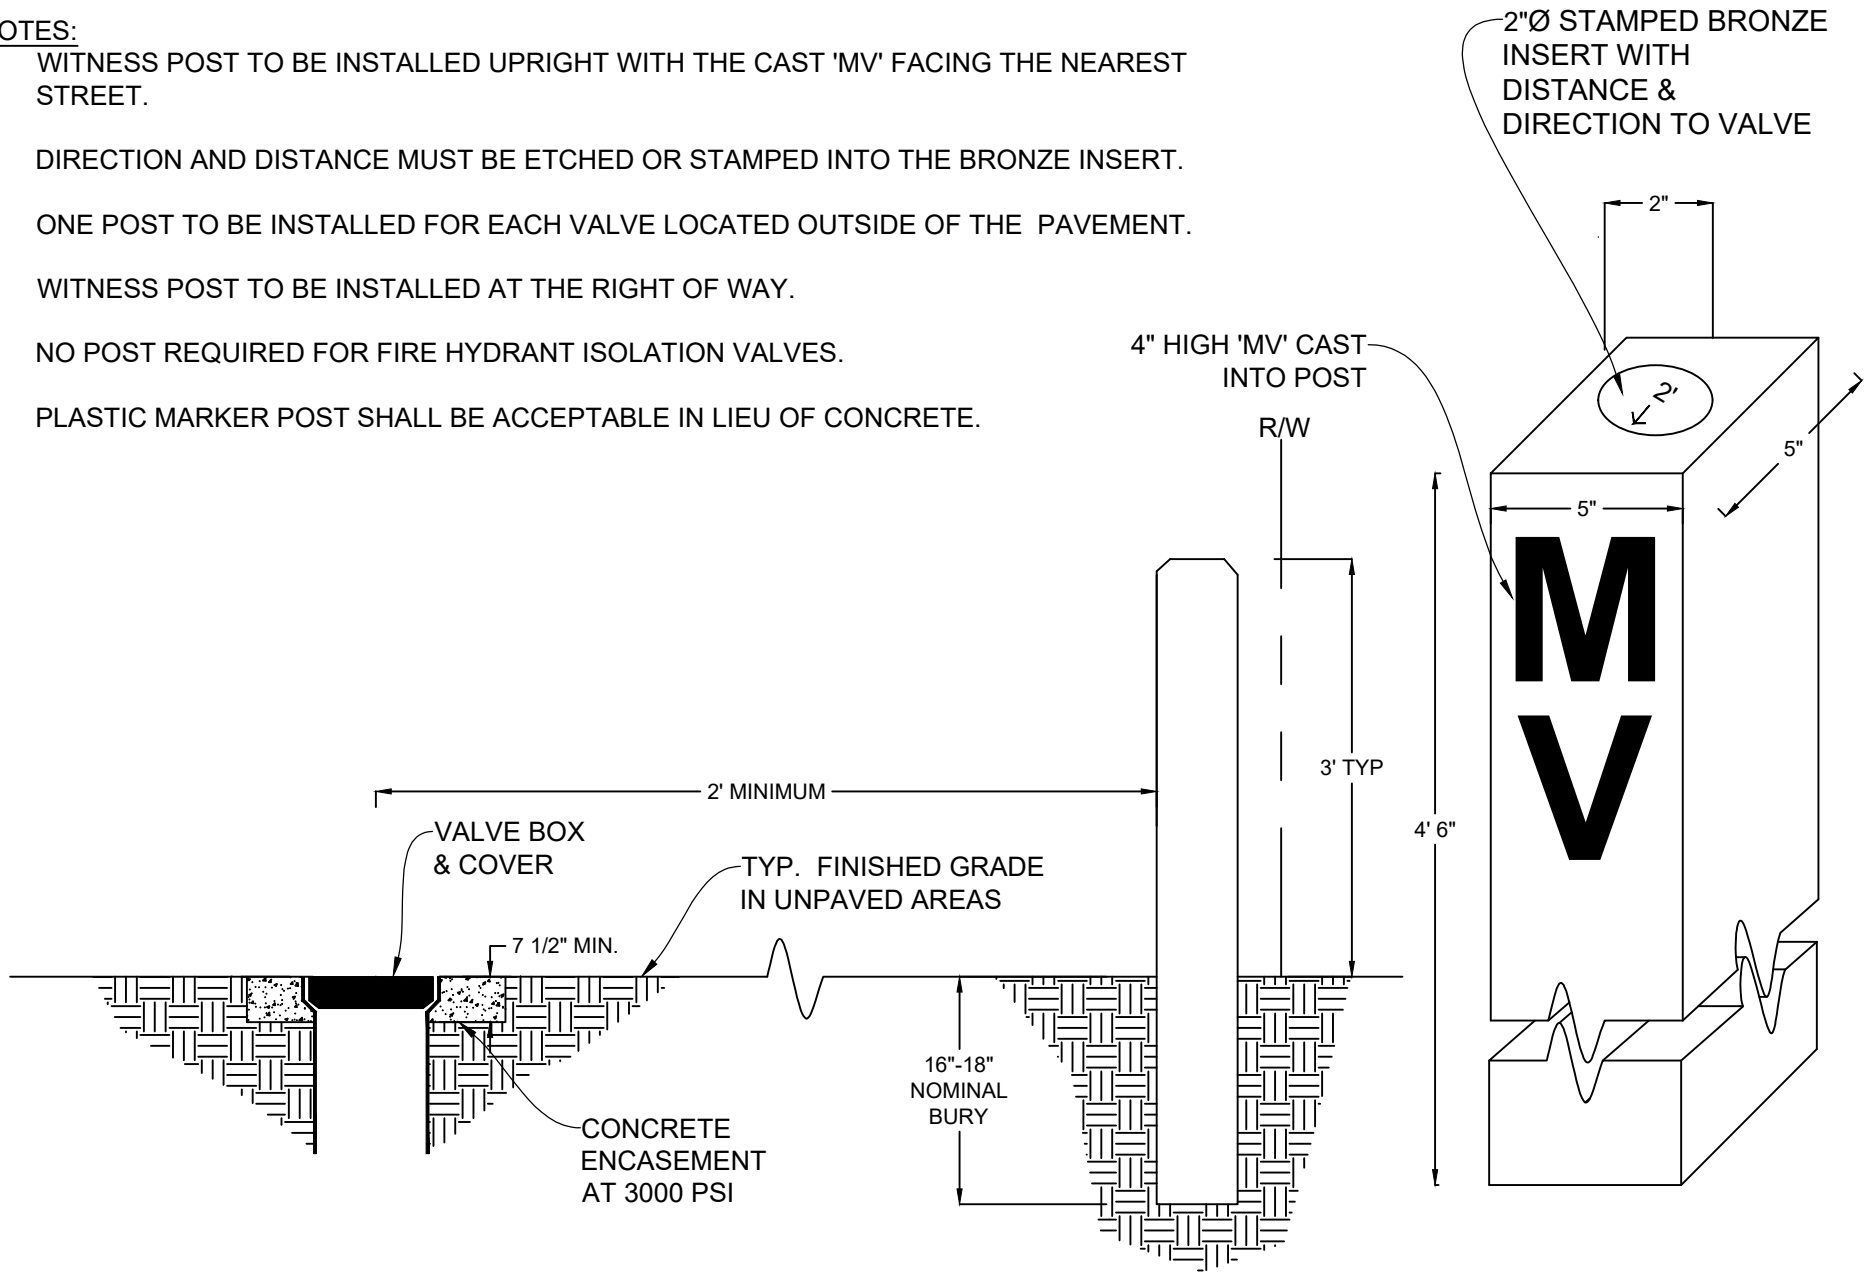

TOWN OF APEX STANDARDS	VALVE BOX MARKER FOR UNPAVED AREAS	STD. NO.
EFFECTIVE: MARCH 23, 2021		600.15
		SHEET 1 OF 1