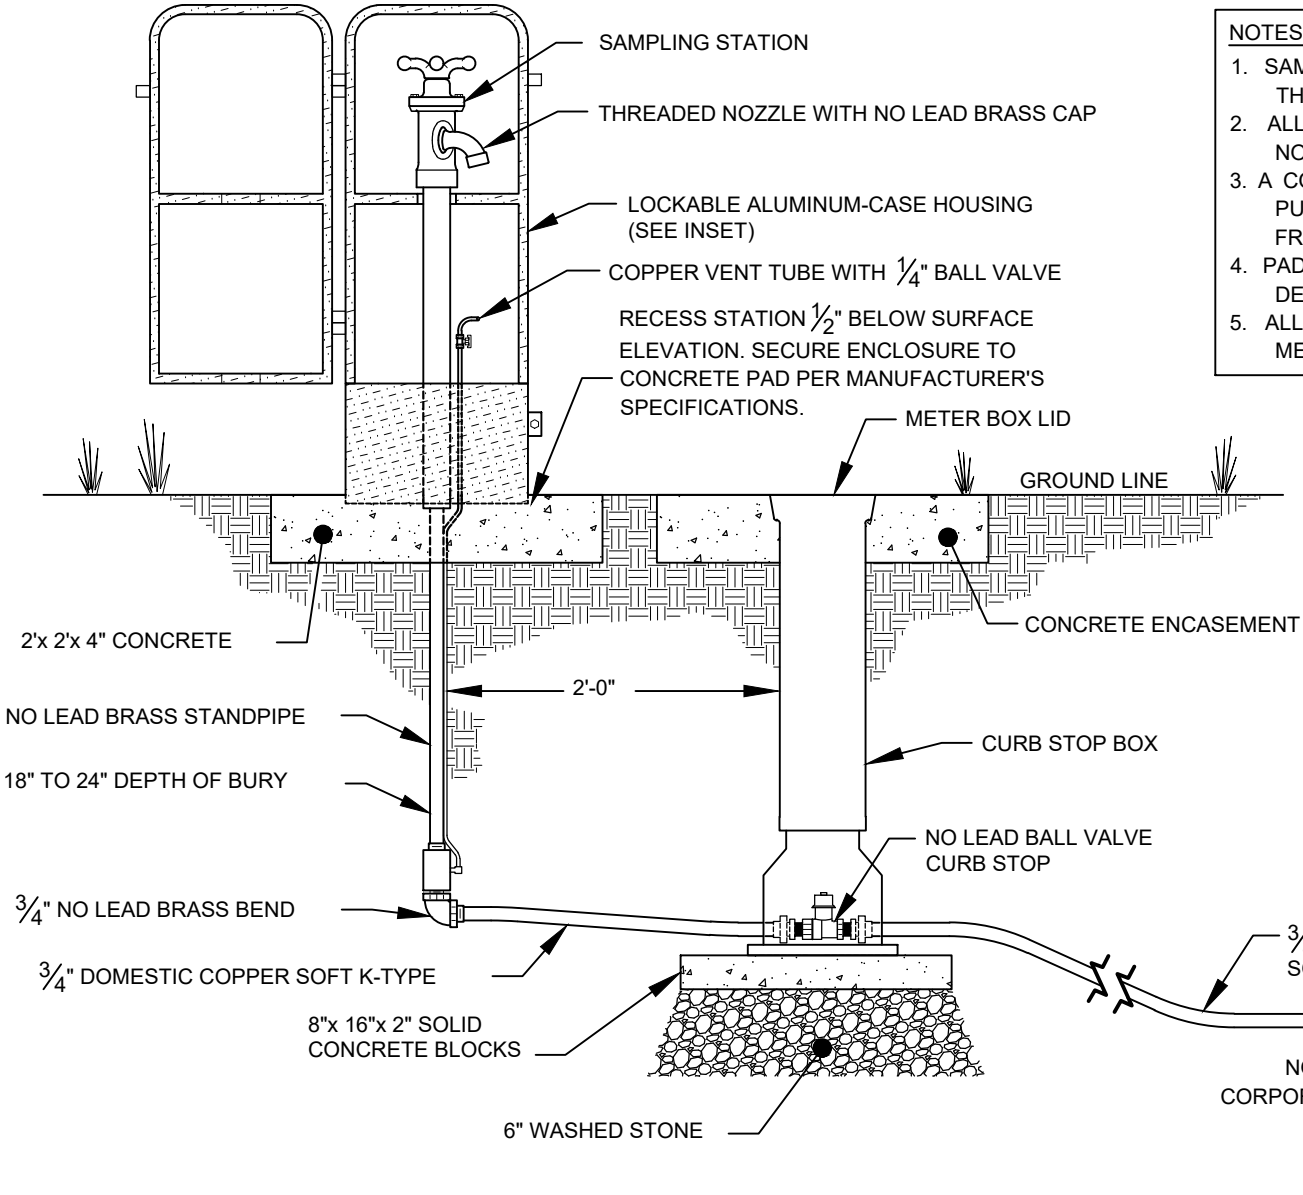

NOTES:

1. SAMPLING STATIONS SHALL BE 18"-24" BURY, WITH A ¾ THREADED NOZZLE WITH 'NO LEAD' BRASS CAP.
2. ALL STATIONS SHALL BE ENCLOSED IN A LOCKABLE, NON-REMOVABLE, ALUMINUM-CAST HOUSING.
3. A COPPER VENT TUBE WILL ENABLE EACH STATION TO BE PUMPED FREE OF STANDING WATER TO PREVENT FREEZING AND TO MINIMIZE BACTERIA GROWTH.
4. PADLOCK PROVIDED BY TOWN OF APEX PUBLIC WORKS DEPARTMENT.
5. ALL BRASS COMPONENTS SHALL BE 'NO LEAD' BRASS MEETING UNS C89833 AS PER ASTM B584.

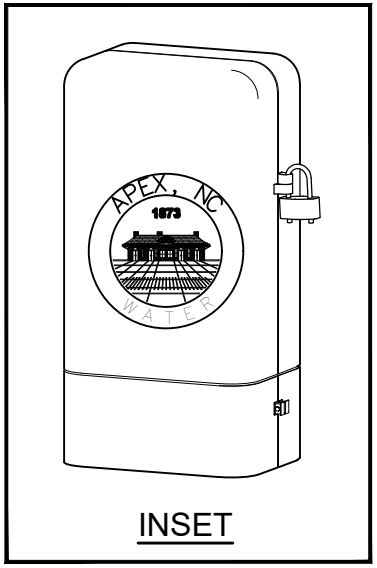

TOWN OF APEX STANDARDS	SAMPLING STATION	STD. NO.
EFFECTIVE: MARCH 23, 2021		600.18
		SHEET 1 OF 1