
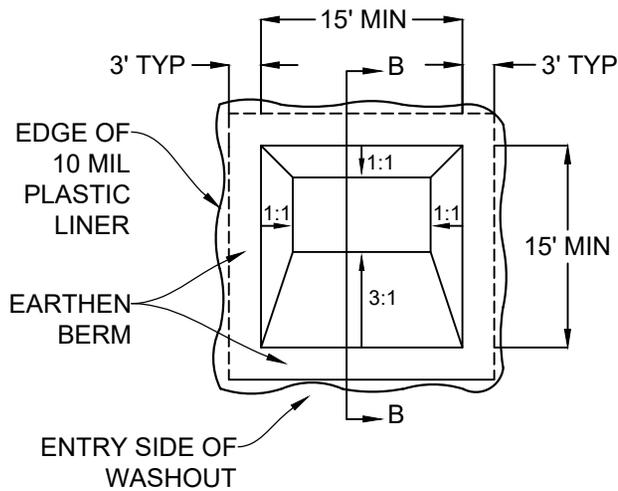
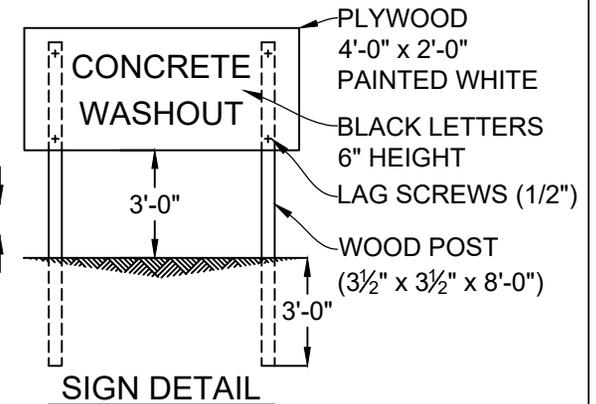


**ABOVE GRADE DETAIL
PLAN VIEW**

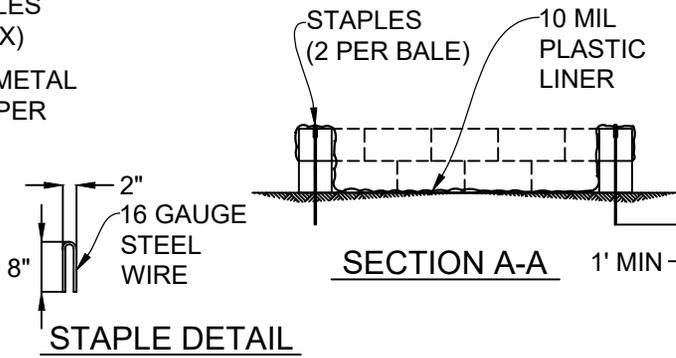


**BELOW GRADE DETAIL
PLAN VIEW**

GENERAL NOTES:

1. DO NOT DISCHARGE CONCRETE OR CEMENT SLURRY FROM THE SITE.
2. THE CONCRETE WASHOUT FACILITY SHOULD BE LOCATED A MINIMUM OF 50' FROM STORM DRAIN INLETS, BUFFERS, OR WATERCOURSES.
3. THE CONCRETE WASHOUT SIGN SHALL BE INSTALLED WITHIN 30' OF THE FACILITY.
4. THE ACTUAL LAYOUT CAN BE DETERMINED IN THE FIELD USING EITHER THE ABOVE GRADE OR BELOW GRADE CONSTRUCTION OPTION.

5. THE CONCRETE WASHOUT FACILITY SHOULD BE CONSTRUCTED AND MAINTAINED IN SUFFICIENT SIZE AND QUANTITY TO CONTAIN ALL LIQUID AND CONCRETE WASTE GENERATED BY THE WASHOUT OPERATION.
6. THE PERIMETER OF THE 10 MIL LINER MUST BE HELD IN PLACE WITH SAND BAGS OR STEEL STAPLES.
7. ONCE CONCRETE WASTES ARE WASHED AND ALLOWED TO HARDEN THE CONCRETE SHOULD BE BROKEN UP, REMOVED AND DISPOSED OF AT AN APPROVED FACILITY IN ACCORDANCE WITH LOCAL AND STATE REGULATIONS. DISPOSE OF HARDENED CONCRETE ONCE THE WASHOUT FACILITY IS 75% FULL.
8. ONCE THE FACILITY IS NO LONGER NEEDED ALL MATERIALS SHALL BE REMOVED AND THE EXISTING GRADES SHALL BE RESTORED.
9. STORMWATER ACCUMULATED WITHIN THE WASHOUT MAY NOT BE DISCHARGED INTO THE STORM DRAIN SYSTEM OR RECEIVING SURFACE WATERS.

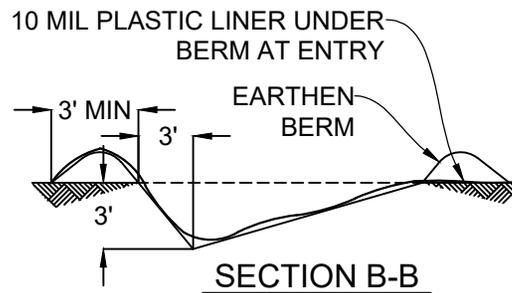

TOWN OF APEX
STANDARDS

EFFECTIVE: MAY 5, 2020

TEMPORARY CONCRETE WASHOUT

STD. NO.

400.20

SHEET 1 OF 1