


CLASS A BEDDING
 REQUIRED FOR DEPTHS ≤ 16 FEET

CLASS B BEDDING
 REQUIRED FOR DEPTHS > 16 FEET

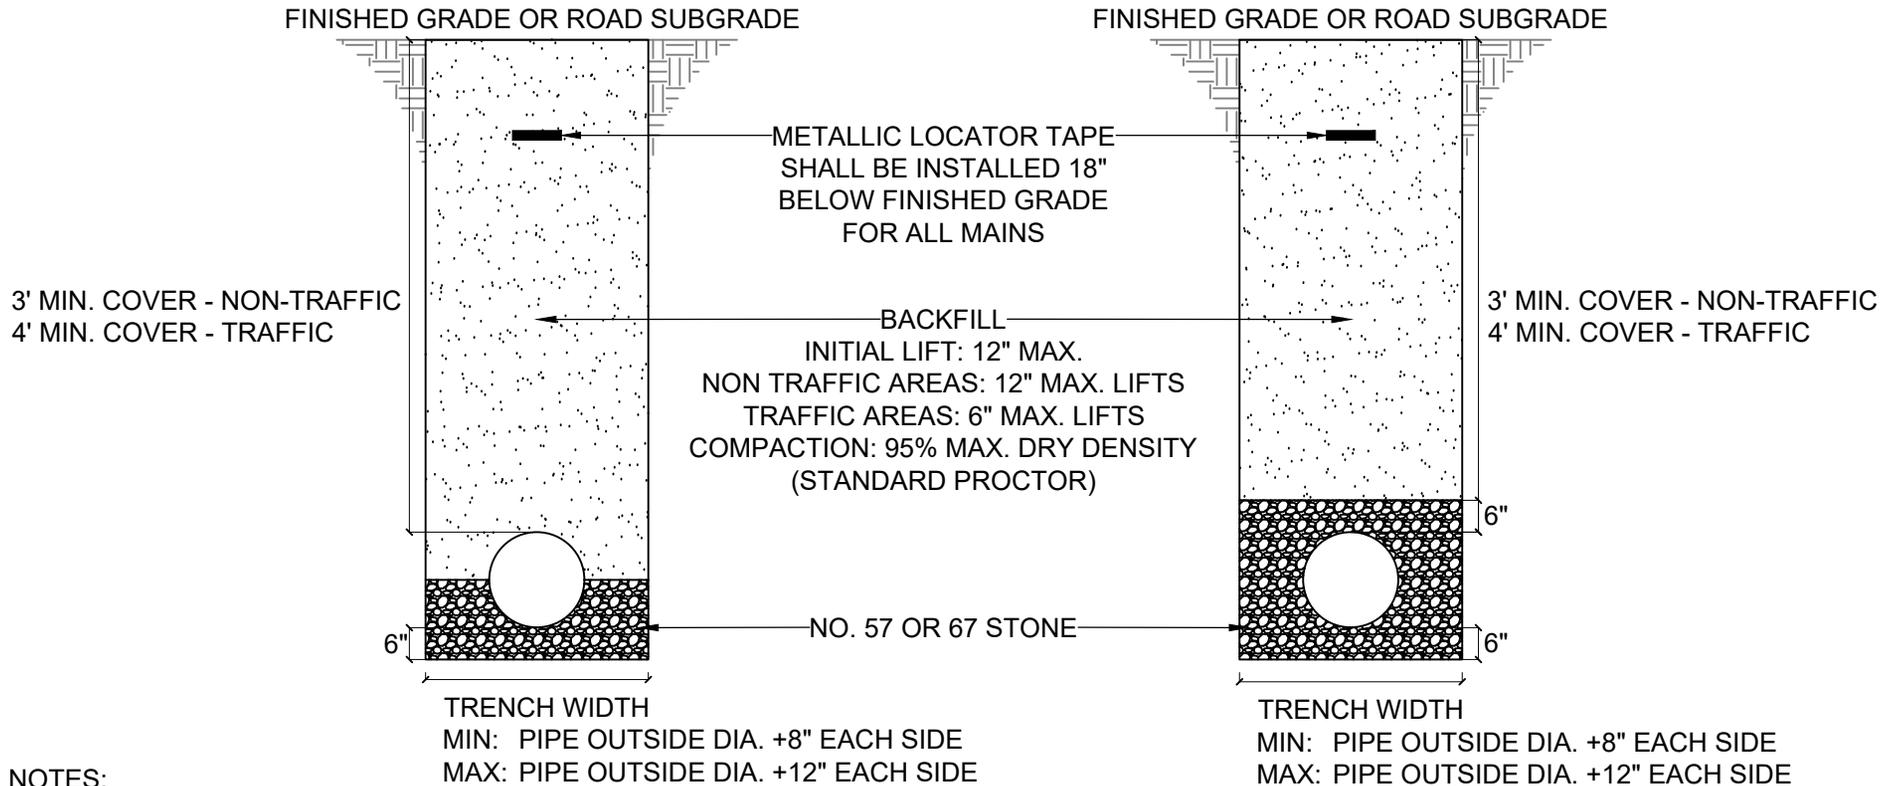

NOTES:

1. FOR TRENCHES REQUIRING SHORING & BRACING, DIMENSIONS SHALL BE TAKEN FROM THE INSIDE FACE OF THE SHORING & BRACING.
2. FLOWABLE FILL MAY BE REQUIRED AT THE DIRECTION OF THE WATER RESOURCES DIRECTOR.
3. NO STONES SHALL BE INCLUDED IN THE BACKFILL MATERIAL FOR AT LEAST 2 FEET ABOVE THE TOP OF THE PIPE.
4. PROVIDE RECESSES TO RECEIVE PIPE BELL.
5. UNDERCUT UNSUITABLE MATERIAL AS DIRECTED BY THE ENGINEER AND BACKFILL WITH APPROVED MATERIAL.
6. WHERE NECESSARY, TEMPORARILY DIVERT SURFACE WATER TO MAINTAIN A DRY CONDITION IN THE PIPE FOUNDATION. DIRECT THIS TEMPORARY FLOW INTO SUITABLE EROSION CONTROL DEVICES.
7. NO ORGANIC MATERIAL PERMITTED FOR BACKFILLING.

TOWN OF APEX
 STANDARDS

SANITARY SEWER PIPE BEDDING & BACKFILLING

EFFECTIVE: MARCH 23, 2021

STD. NO.

450.02

SHEET 1 OF 1