


3" DIAMETER SCHEDULE 40 PVC PIPE THROUGH CURB.
THE EDGES OF THE DRAIN HOLE MUST BE ROUNDED
AND FINISHED SMOOTH AT THE FACE OF THE CURB.

NOTES:

1. CURB DRAINS SHALL NOT BE CONSTRUCTED WITHIN 18" OF CONTRACTION OR EXPANSION JOINTS.
2. OPENING GRADE MAY VARY BETWEEN A MAXIMUM SLOPE OF 1/2" PER FOOT AND A MINIMUM OF 1/4" PER FOOT.
3. MORE THAN ONE HOLE MAY BE INSTALLED PROVIDED THE HOLES ARE LOCATED WITH 18" MINIMUM SPACING.

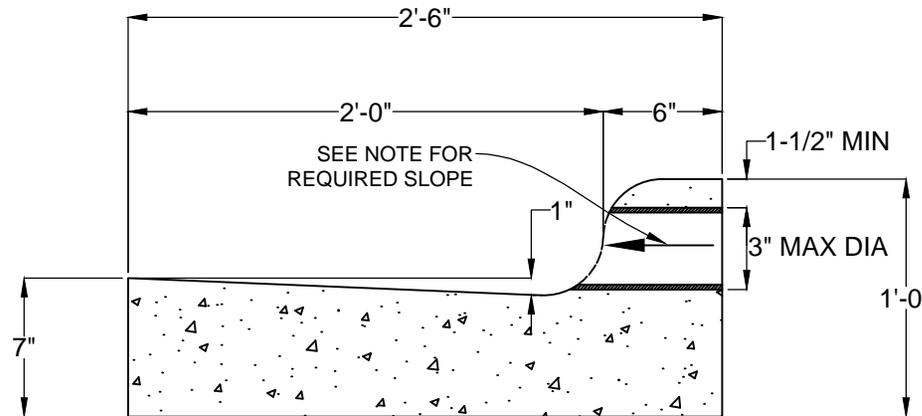

TOWN OF APEX
STANDARDS

EFFECTIVE: DECEMBER 3, 2002

CURB DRAIN

STD. NO.

300.06

SHEET 1 OF 1