




| CONCRETE DEPTH | |
|----------------|----|
| RAMP/FLARE | 6" |
| LANDING | 4" |

 PAY LIMITS FOR CURB RAMP

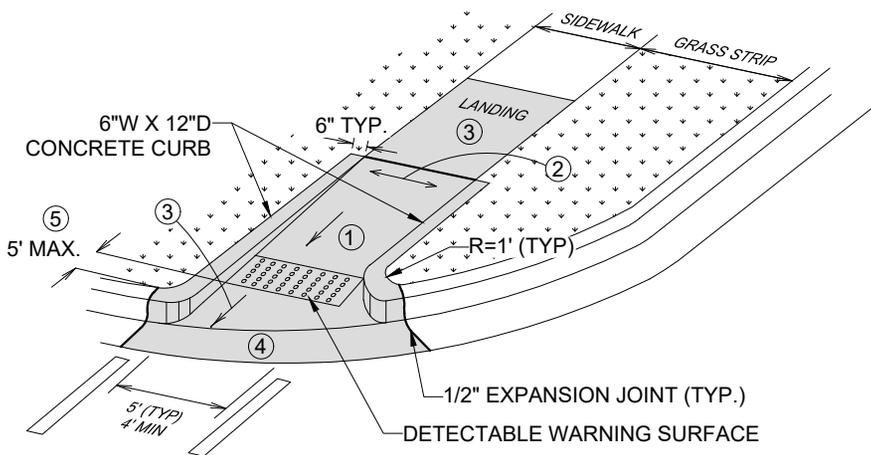


TYPE N-1 (CURB TYPE)

1. RUNNING SLOPE: 5% MIN./8.33% (12:1) MAX.
2. CROSS SLOPE: 2% MAX. RAMPS AND DOMES SHALL BE INSTALLED THE SAME WIDTH AS THE SIDEWALK.
3. CURB RAMPS REQUIRE A (4'-0") MINIMUM LANDING WITH A MAXIMUM CROSS SLOPE AND LONGITUDINAL SLOPE OF 2.00% WHERE PEDESTRIANS PERFORM TURNING MANEUVERS. SLOPE TO DRAIN TO CURB.
4. CROSS SLOPE NOT TO EXCEED 2% ANY PORTION OF TRANSITION TO STREET.
5. IF LENGTH EXCEEDS 5', TRUNCATED DOMES SHALL BE INSTALLED ALONG THE BACK OF THE CURB COVERING THE FULL WIDTH OF THE RAMP.

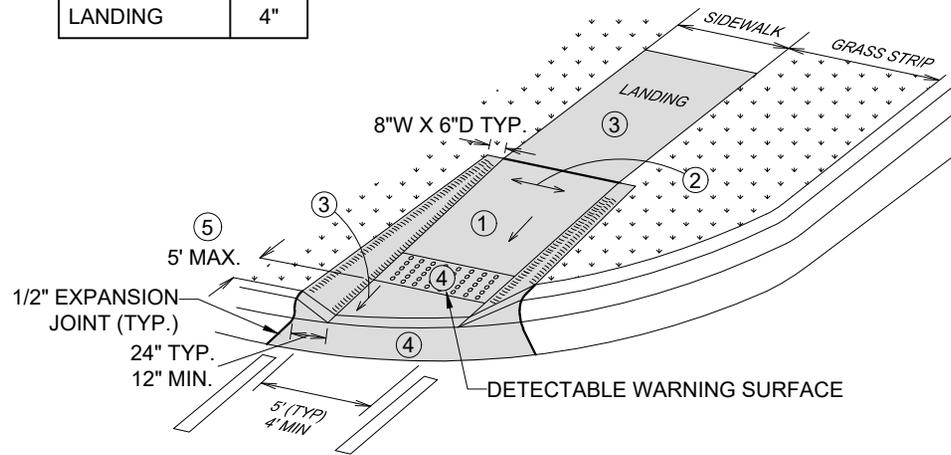


TYPE N-1A (FLARE TYPE)

NOTE: USE SMALL FLARES ONLY WHEN A CURB TYPE DIRECTLY CONFLICTS WITH APPROACHING VEHICULAR TURNING MOVEMENTS.

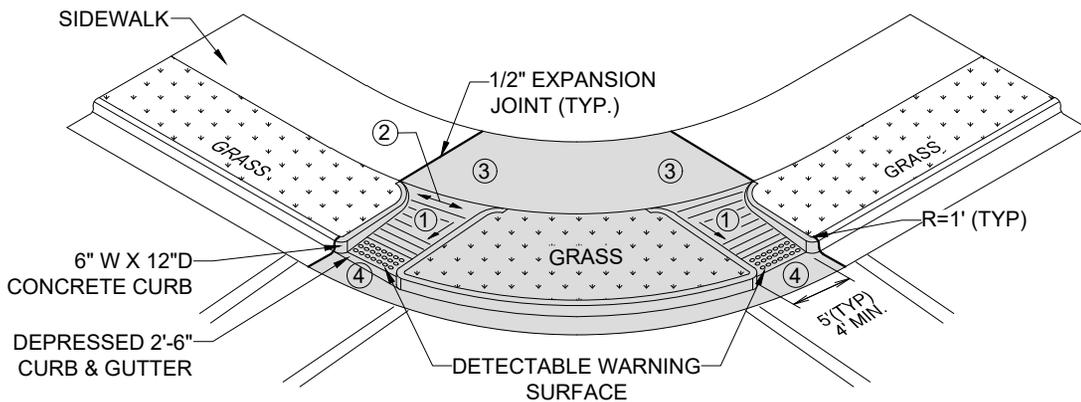

TYPE N-2 (RADIUS)

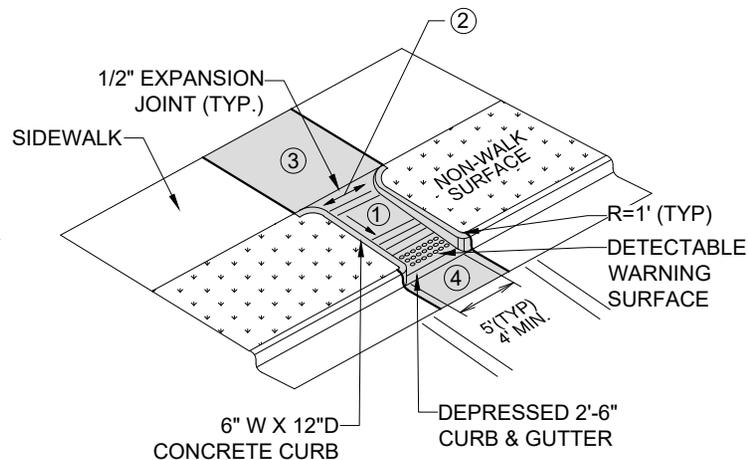

TYPE N-2 (TEE INTERSECTION)