
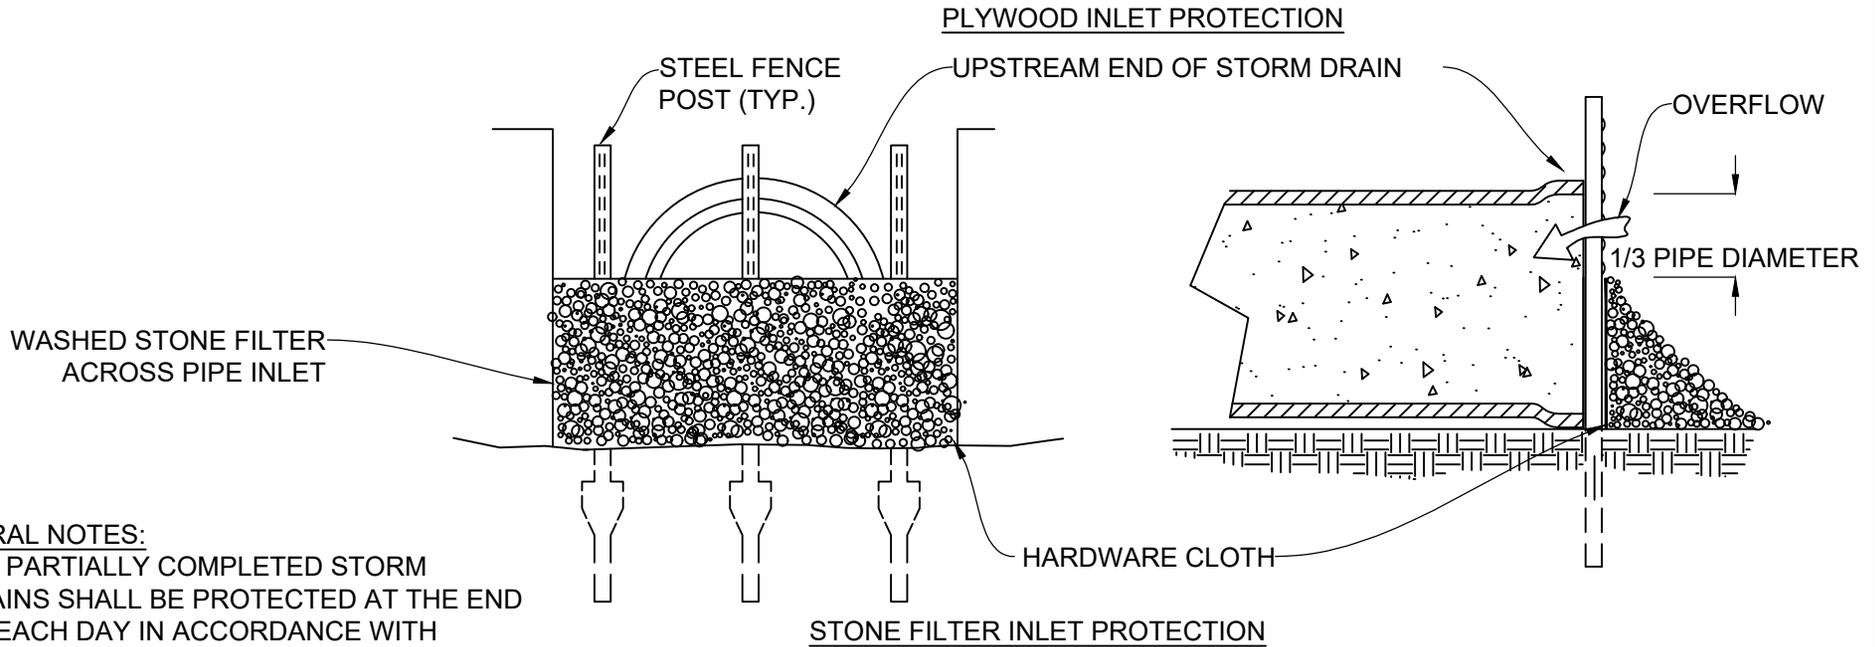


MAINTENANCE NOTES:

1. REMOVE SEDIMENT AND RESTORE STORAGE AREA WHEN SEDIMENT HAS ACCUMULATED TO $\frac{1}{2}$ DESIGN DEPTH OF TRAP.
2. REPLACE STONE AS NEEDED TO RESTORE TO INITIAL INSTALLATION CONDITIONS WHEN STONE BECOMES CLOGGED OR DISLODGED.

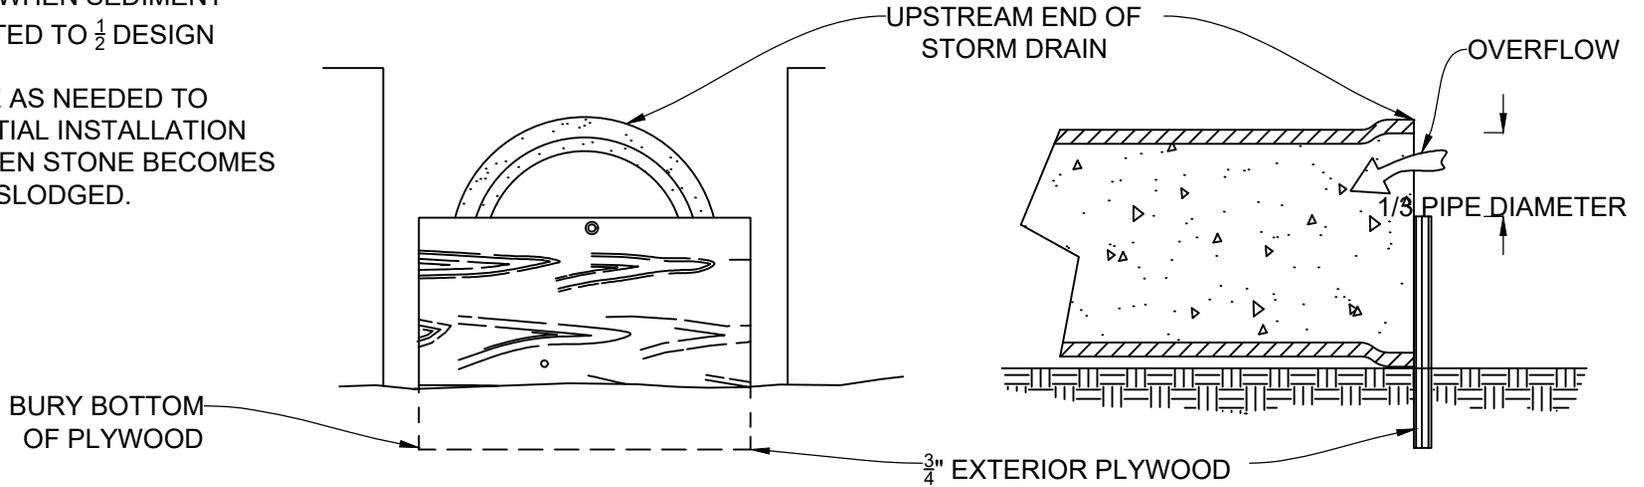

GENERAL NOTES:

1. ALL PARTIALLY COMPLETED STORM DRAINS SHALL BE PROTECTED AT THE END OF EACH DAY IN ACCORDANCE WITH THESE DETAILS.

TOWN OF APEX
STANDARDS

EFFECTIVE: JUNE 11, 2024

PIPE INLET PROTECTION (PLYWOOD & STONE)

STD. NO.

400.10

SHEET 1 OF 1