


PRECAST CONCRETE SLAB


NOTES:

1. EITHER SOLID BLOCK OR PRECAST CONCRETE MAY BE USED.
2. CAST IN PLACE DESIGNS TO BE SUBMITTED.
3. CONCRETE WALLS TO BE 6" THICK MIN.
4. STEPS REQUIRED AT 16" O.C. THROUGHOUT, WHERE DEPTH EXCEEDS 3'.
5. USE ONLY 3000 PSI CONCRETE MIX.
6. INSIDE DIMENSION FOR  $\geq 24"$  PIPE, USE PIPE DIAMETER PLUS 12".

STANDARD MANHOLE RING AND COVER IN LINE WITH STEPS  
MAY BE CAST IN SLAB OR SECURED TO TOP OVER STEPS

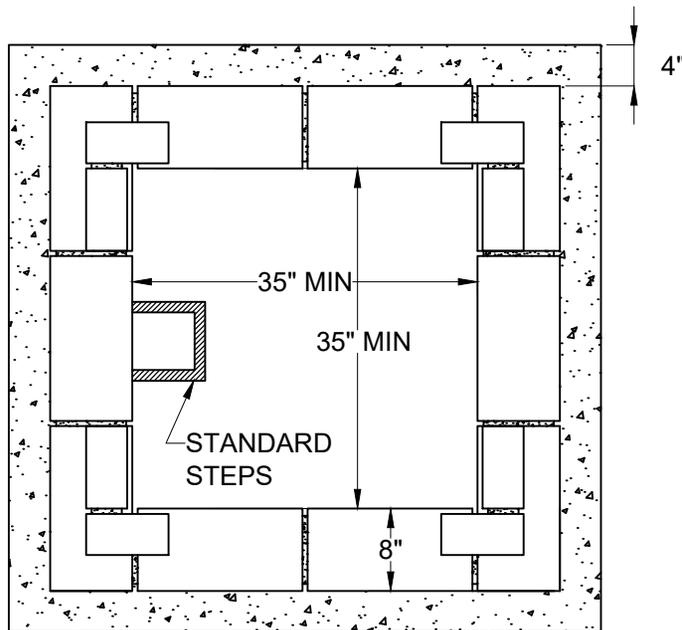

PLAN

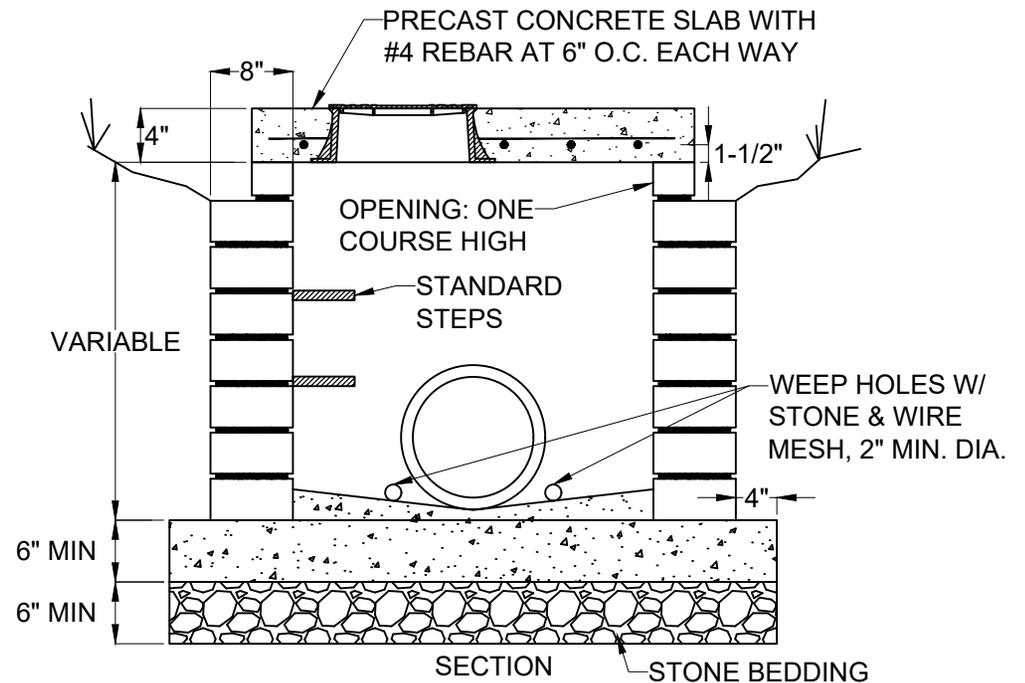

SECTION

STONE BEDDING

TOWN OF APEX  
STANDARDS

EFFECTIVE: AUGUST 12, 2025

YARD INLET W/ CONCRETE SLAB

STD. NO.

500.01

SHEET 1 OF 1