


NOTES:

1. INSTALLATIONS LARGER THAN 3" SHALL REQUIRE A SPECIAL DETAIL AND PRIOR APPROVAL FROM THE WATER RESOURCES DEPARTMENT.
2. ALL PIPE SHALL BE DUCTILE IRON. A BYPASS LINE MUST BE INCLUDED.
3. THERE SHALL BE A MINIMUM 5' EASEMENT AROUND ALL SIDES OF THE WATER METER VAULT.
4. CONTACT WATER RESOURCES OPERATIONS FOR COST OF METERS 3" AND GREATER AND THE OPENING REQUIRED FOR INSTALLATION OF METER.
5. VAULT PIPE INLET AND OUTLET SHALL BE SEALED AROUND PIPE WITH CONCRETE OR WITH BRICK AND MORTAR.
6. METER VAULT TOP SHALL HAVE A 4-1/8" DIAMETER RECESSED HOLE FOR TRANSMITTER.

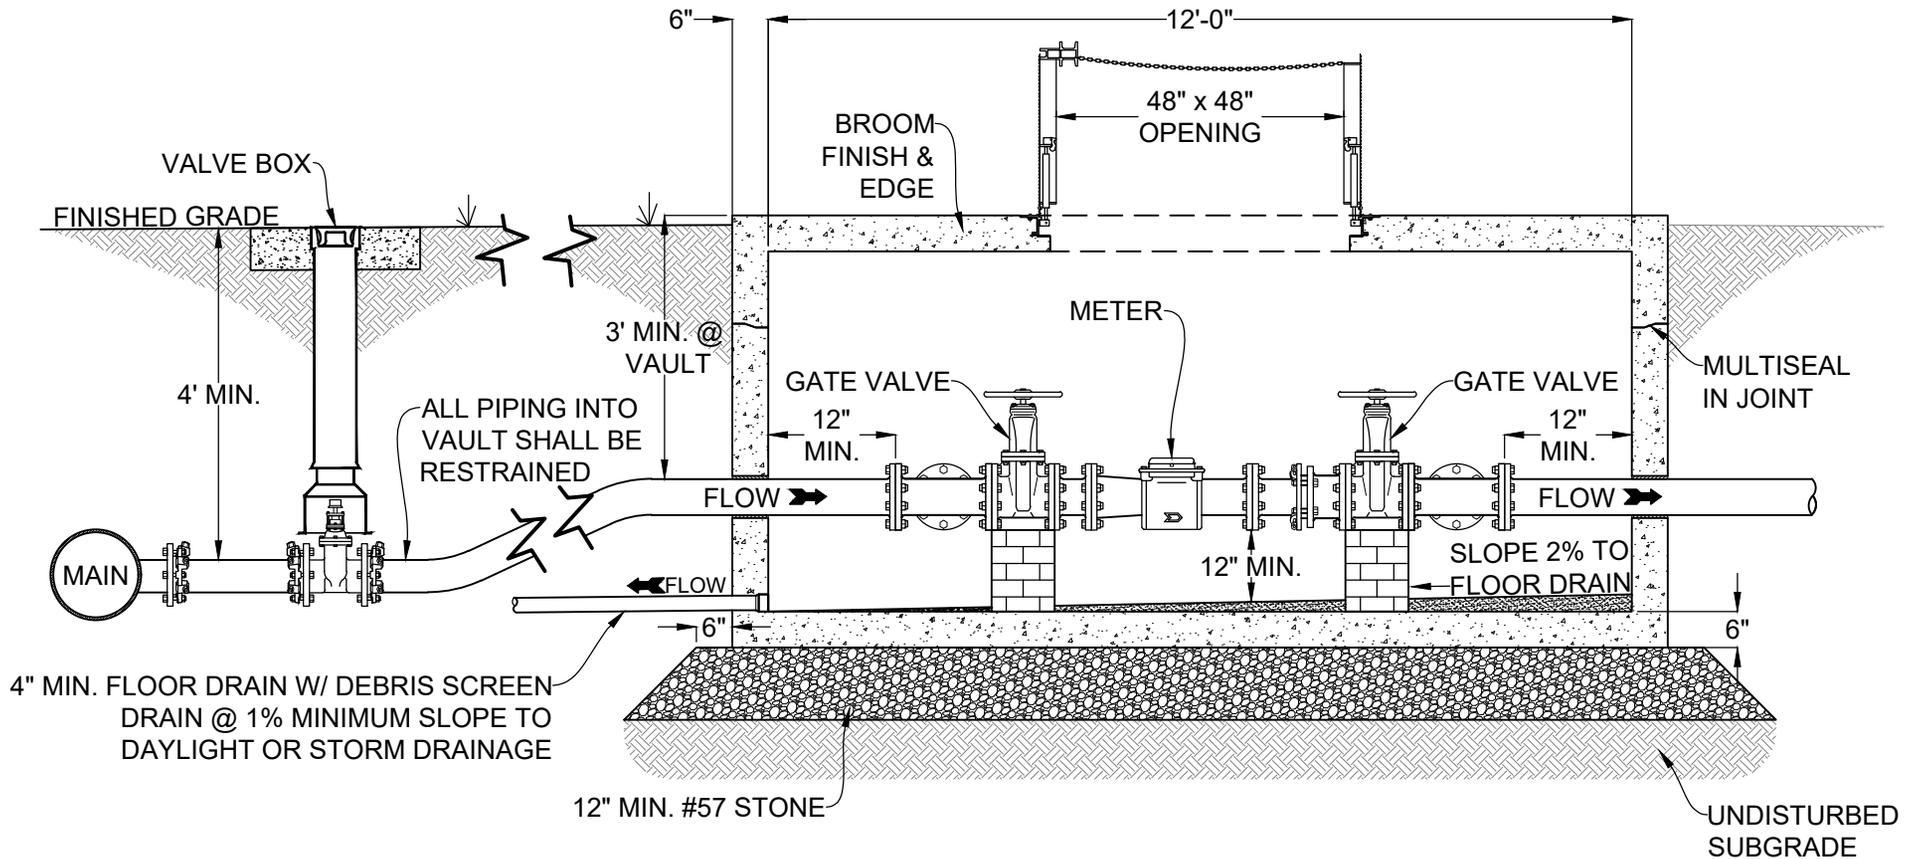

SECTION VIEW

**TOWN OF APEX
STANDARDS**

EFFECTIVE: JUNE 11, 2024

3" & LARGER METER INSTALLATION & VAULT

STD. NO.

600.03

SHEET 1 OF 2