


**NOTES:**

1. HYDRANT TO BE PLACED WITH PUMPER NOZZLE FACING THE CLOSEST CURB.
2. HYDRANT TO BE PAINTED ONE COAT OF RED AFTER INSTALLATION.
3. WATER SERVICES SHALL NOT BE PERMITTED ON HYDRANT LEGS.
4. THERE SHALL BE A 10 FOOT EASEMENT ON ALL SIDES OF THE HYDRANT, CLEAR OF ANY OBSTRUCTIONS.
5. HYDRANTS SHALL BE SPACED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS SECTION 600.

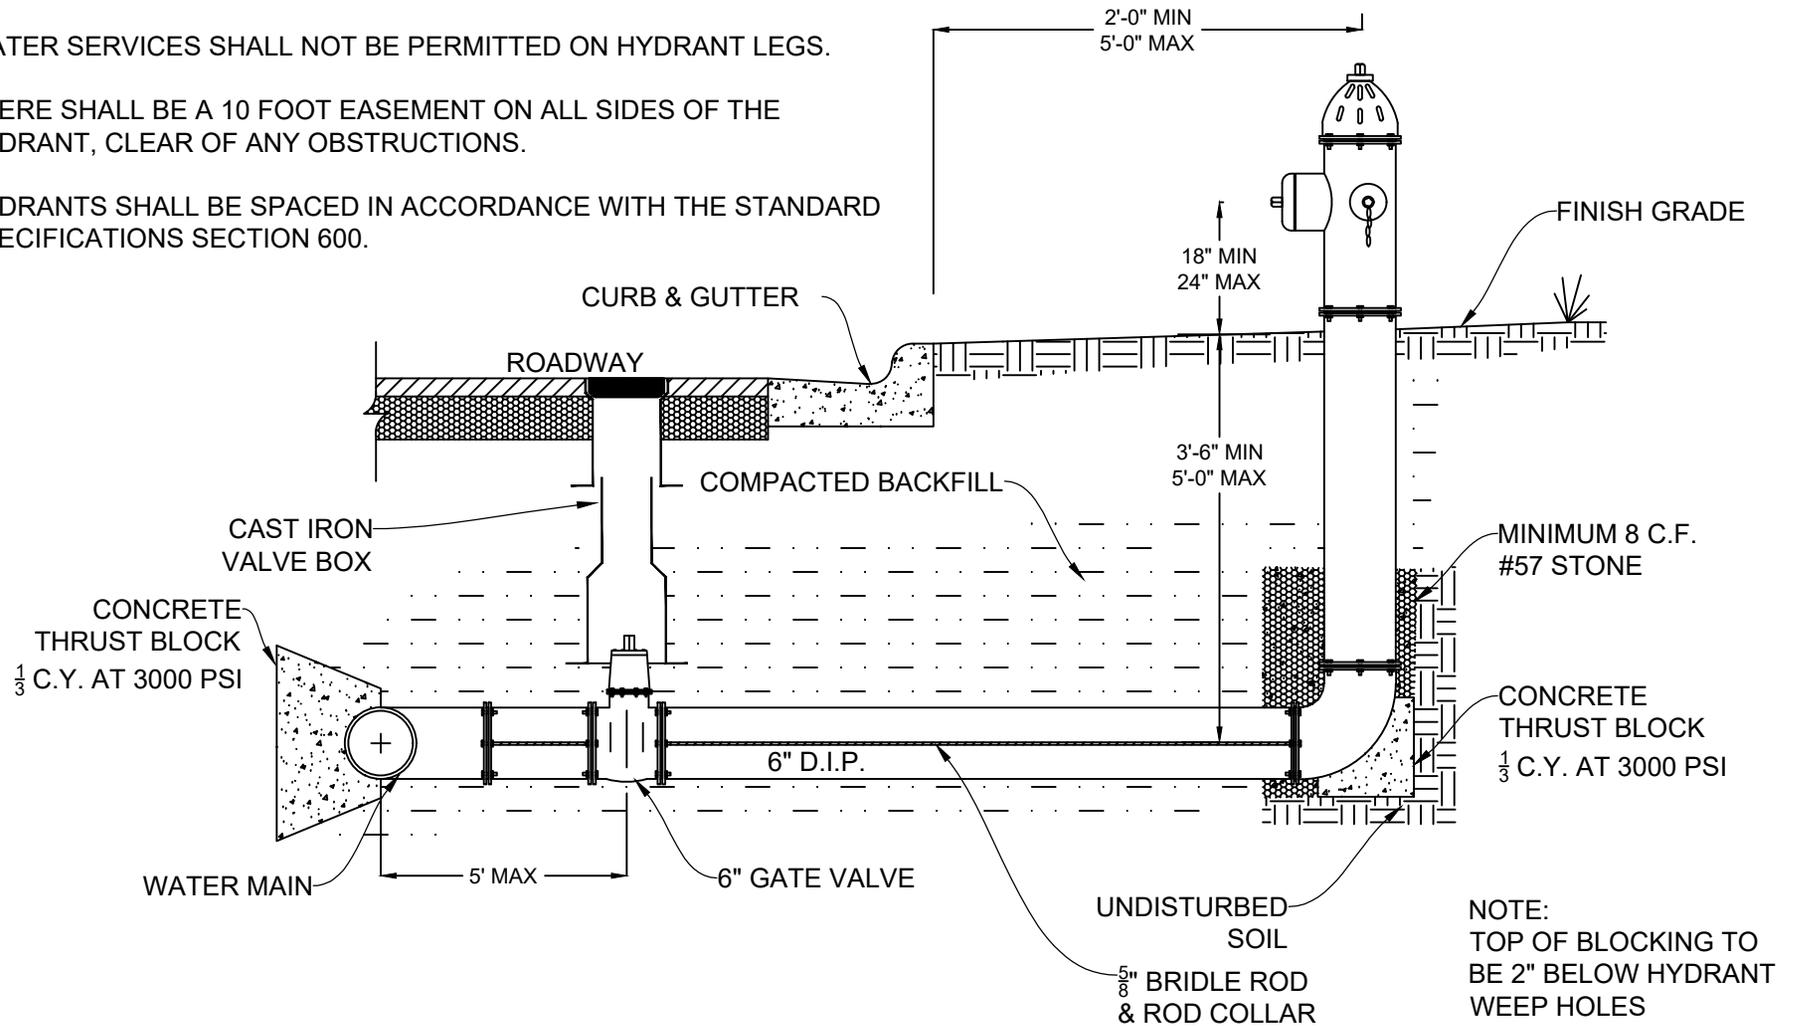

**TOWN OF APEX  
STANDARDS**

**HYDRANT INSTALLATION**

STD. NO.

**600.05**

EFFECTIVE: MARCH 23, 2021

SHEET 1 OF 1