


NOTES:

1. TAP SIZE AND ISOLATION VALVE TO BE SAME SIZE AS AIR VALVE.
2. ALL PIPING AND FITTINGS IN THE MANHOLE SHALL BE BRASS OR BRONZE UNLESS NOTED OTHERWISE.
3. MANHOLE STEPS SHALL BE PLACED 16" O.C. WHEN DEPTH OF MANHOLE EXCEEDS 4 FEET.
4. MANHOLE INTERIOR SHALL BE EPOXY COATED IN THE CASE OF SEWER.
5. WATER MAINS 16" AND LARGER OR IN OUTFALLS MAY REQUIRE 5 FOOT DIAMETER MANHOLES AND/OR FLAT TOP MANHOLES.

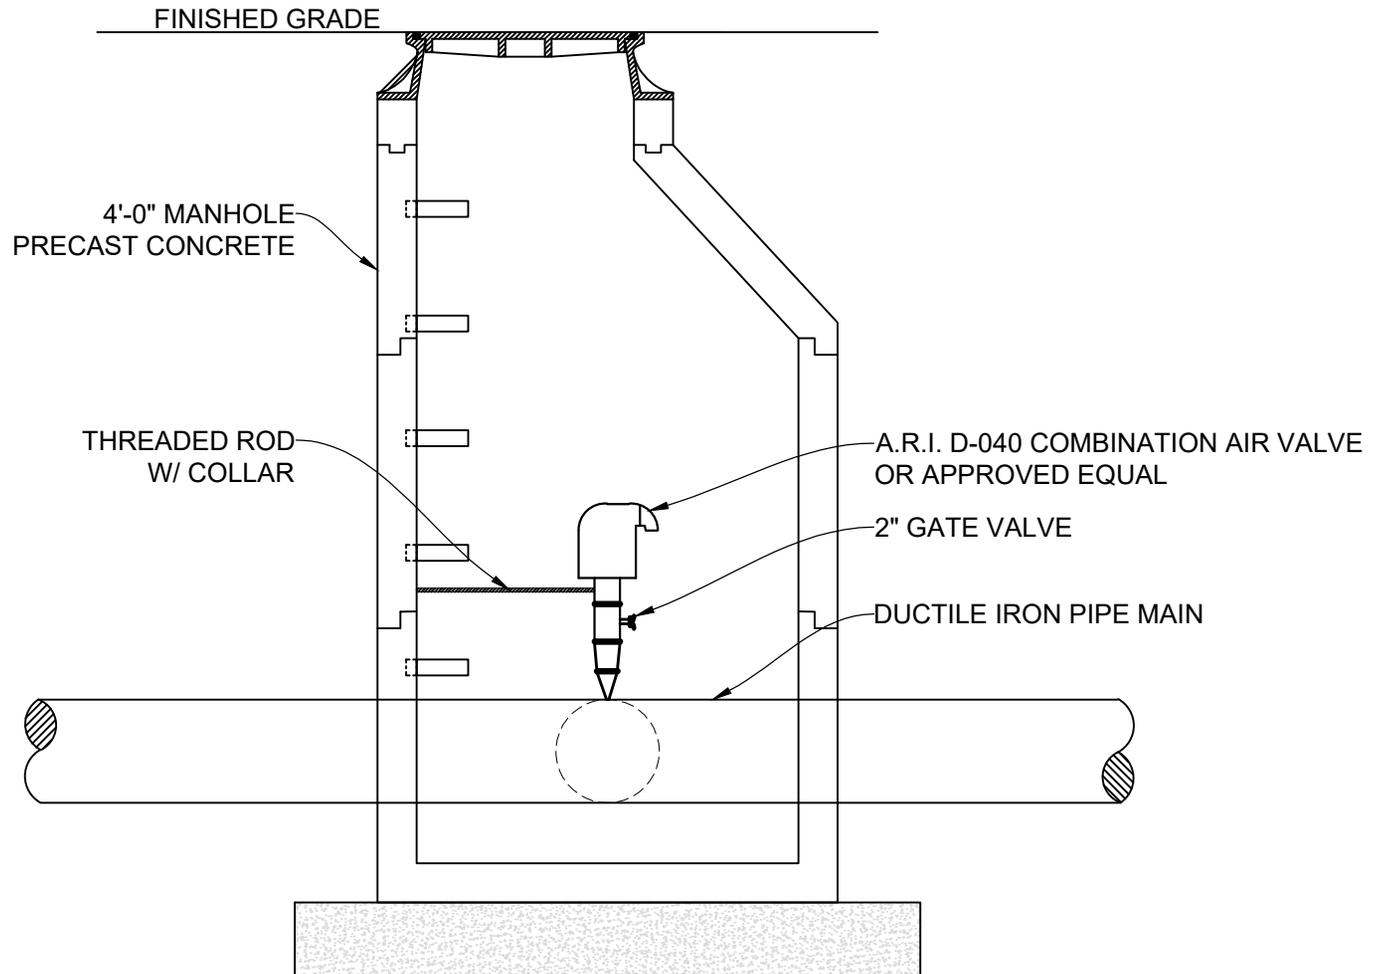

TOWN OF APEX  
STANDARDS

EFFECTIVE: APRIL 12, 2022

## AIR RELEASE MANHOLE FOR WATER MAINS

STD. NO.

600.12

SHEET 1 OF 2