


NOTES:

1. THE SEWER LINE ENTERING A DROP MANHOLE SHALL BE CONTINUOUS MATERIAL FROM THE UPSTREAM MANHOLE.
2. ONE INSIDE DROP PERMITTED WITHIN A 5' Ø MANHOLE. TWO INSIDE DROPS PERMITTED WITHIN A 6' Ø MANHOLE.
3. A DROP MANHOLE IS REQUIRED WHEN THE DIFFERENCE BETWEEN INVERTS EXCEEDS 24".
4. ALL JOINTS WITHIN THE MANHOLE SHALL BE OF THE MECHANICAL JOINT TYPE.
5. INSIDE DROP PIPE DIAMETER SHALL BE THE SAME AS THE INFLOW SEWER LINE DIAMETER.
6. STAINLESS STEEL STRAPPING SHALL BE 1" WIDE BY  $\frac{1}{8}$ " THICK AND ATTACHED TO THE MANHOLE WALL WITH MASONRY ANCHORS.
7. WHERE DROP EXCEEDS 24", A SERVICE DROP CONNECTION WITH CLEANOUT SHALL BE PROVIDED IN ACCORDANCE WITH THE STANDARD DETAIL.

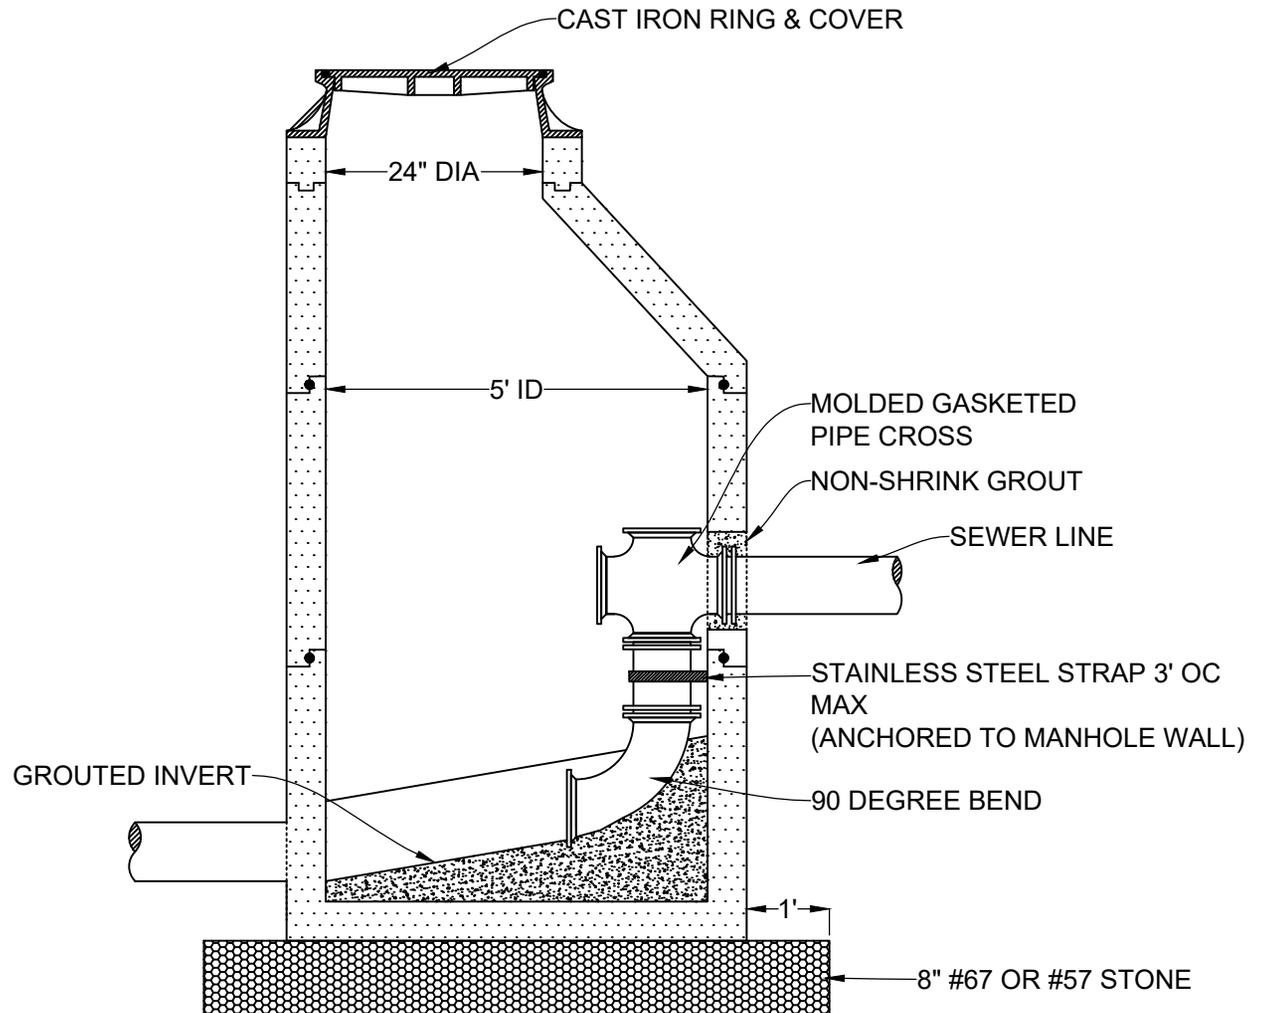

ELEVATION