
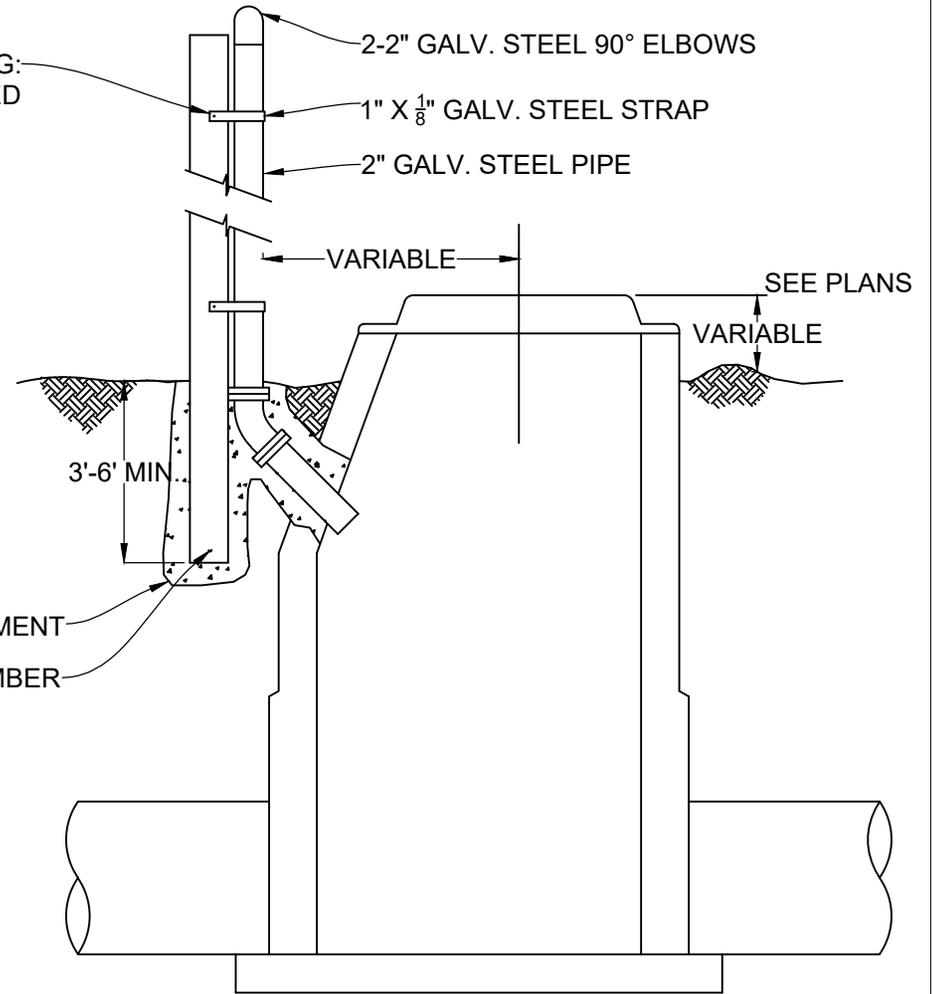


VENT

STRAP SPACING:  
1 EVERY 3' & MINIMUM OF 2 REQUIRED

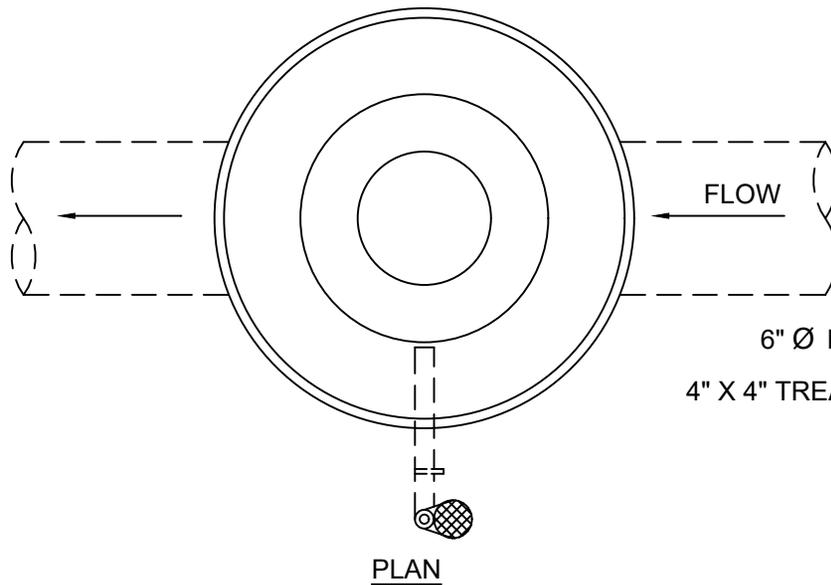

NOTES:

1. LOCATION OF VENT PIPE SHALL BE AS DIRECTED BY THE CONSTRUCTION INSPECTOR.
2. WATERTIGHT RING AND COVER VENT TOP TO BE A MINIMUM OF 2FT. ABOVE 100 YEAR FLOOD PLAIN ELEVATION.

TOWN OF APEX  
STANDARDS

EFFECTIVE: MARCH 23, 2021

MANHOLE VENT

STD. NO.

700.13

SHEET 1 OF 1