


TOWN MAINTENANCE ENDS AT R/W.

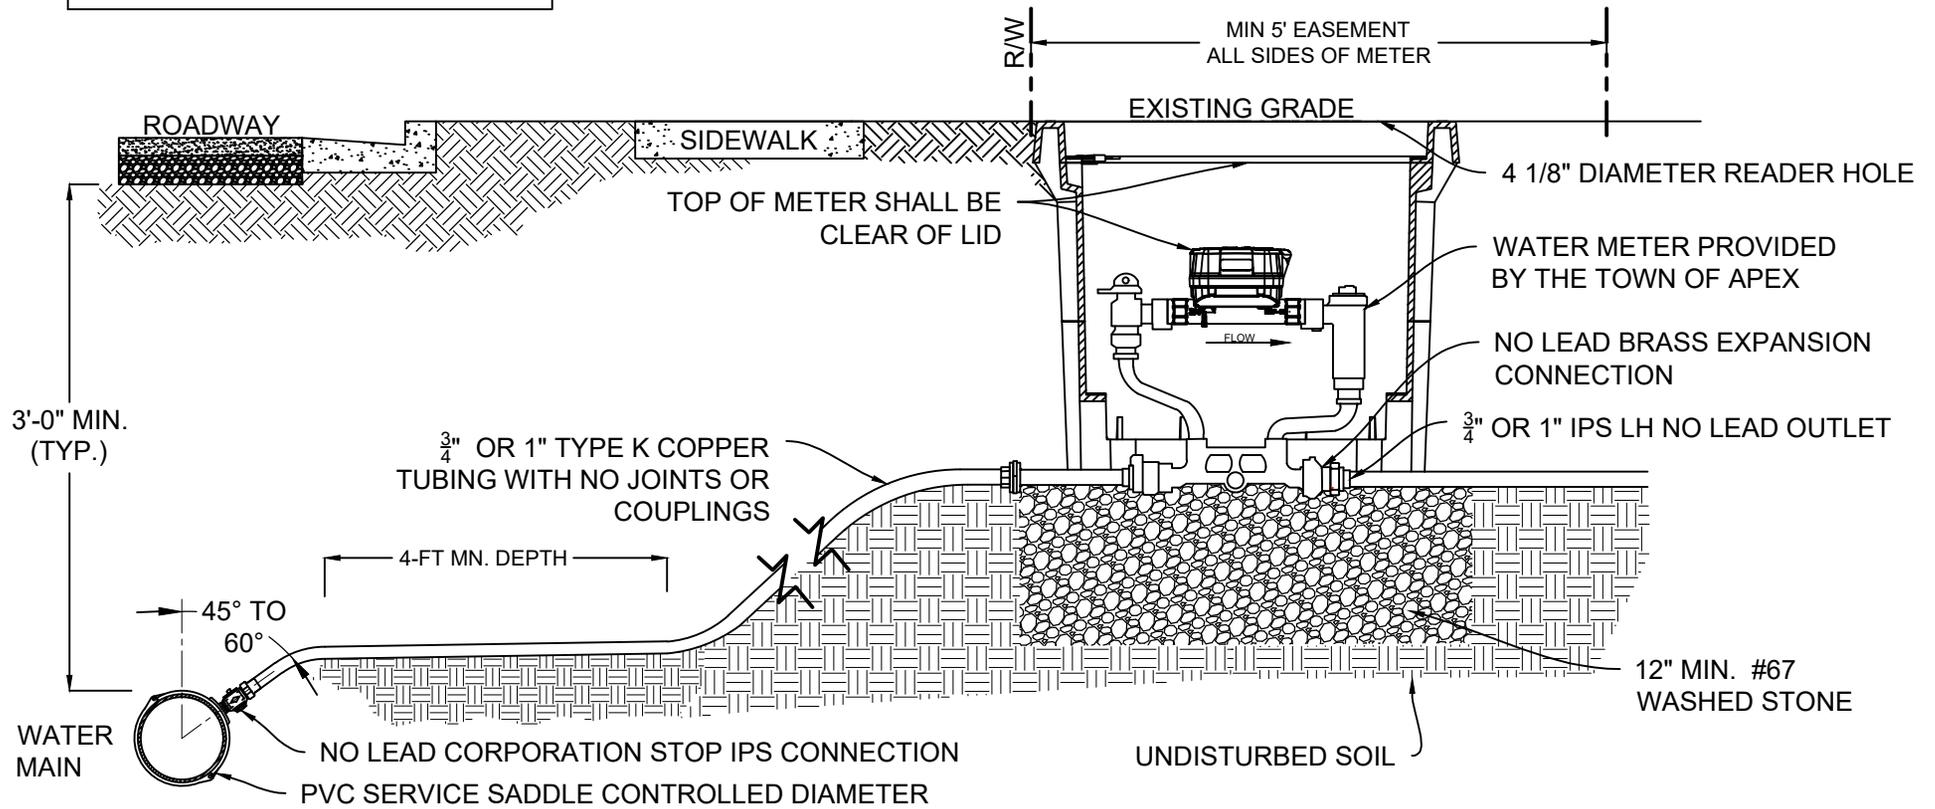

NOTES:

1. WATER METER SHALL NOT BE LOCATED IN AREAS SUBJECT TO VEHICULAR TRAFFIC.
2. ALL SERVICE LINES, VALVES AND FITTINGS SHALL COMPLY WITH AWWA C800.
3. THE INTERIOR AND EXTERIOR OF THE BOX AND LID SHALL BE COLORED BLACK.
4. ALL RELOCATIONS OF EXISTING OR PERMITTED INFRASTRUCTURE INCLUDING SERVICE PIPING AND METER BOXES SHALL BE PERMITTED AND INSPECTED IN CONFORMANCE WITH TOWN POLICIES AND PROCEDURES.
5. BOX AND LID SHALL BE HDPE.
6. COPPER TUBING SHALL BE LEAD FREE, TYPE K SOFT COPPER TUBING CONFORMING TO ASTM STANDARD B58.
7. MARKING TAPE SHALL BE INSTALLED FOR ALL SERVICE CONNECTIONS FROM THE MAIN LINE TO THE METER FOR ALL NEW CONSTRUCTION OR RETROFIT INSTALLATIONS USING OPEN TRENCH METHODS.
8. METER BOX LID SHALL HAVE A 4-1/8 INCH DIAMETER RECESSED HOLE FOR TRANSMITTER.
9. SEE APPROVED MATERIAL LIST; SECTION 600.

NO WATER SERVICES ARE PERMITTED ON HYDRANT LEGS, WITHIN 3' OF PIPE BELL, OR WITHIN 20' OF DEAD END.

TOWN OF APEX
STANDARDS

EFFECTIVE: JUNE 11, 2024

3/4" & 1" WATER SERVICE & METER BOX

STD. NO.

600.01

SHEET 3 OF 3